

# Analysis of Possible Explosions at Kennedy Space Center

## Due to Spontaneous Ignition of Hypergolic Propellants

## 1.0 INTRODUCTION

NASA's Constellation Program plan currently calls for the replacement of the Space Shuttle with the ARES I & V spacecraft and booster vehicles to send astronauts to the moon and beyond. Part of the ARES spacecraft is the Orion Crew Exploration Vehicle (CEV), which includes the Crew Module (CM) and Service Module (SM). The Orion CM's main propulsion system and supplies are provided by the SM. The SM is to be processed off line and moved to the Vehicle Assembly Building (VAB) for stacking to the first stage booster motors prior to ARES move to the launch pad. The new Constellation Program philosophy to process in this manner has created a major task for the KSC infrastructure in that conventional QD calculations are no longer viable because of the location of surrounding facilities near the VAB and the Multi Purpose Processing Facility (MPPF), where the SM will be serviced with nearly 18,000 pounds of hypergolic propellants.

The Multi-Payload Processing Facility (MPPF) complex, constructed by NASA in 1994, is located just off E Avenue south of the Operations and Checkout (O&C) building in the Kennedy Space Center industrial area. The MPPF includes a high bay and a low bay. The MPPF high bay is 40.2 m (132 ft) long x 18.9 m (60 ft) wide with a ceiling height of 18.9 m (62 ft). The low bay is a 10.4 m (34 ft) long x 10.4 m (34 ft) wide processing area and has a ceiling height of 6.1 m (20 ft). The MPPF is currently used to process non-hazardous payloads.

Engineering Analysis Inc. (EAI), under contract with ASRC Aerospace, Inc. in conjunction with the Explosive Safety Office, NASA, Kennedy Space Center (KSC), has carried out an analysis of the effects of explosions at KSC in or near various facilities produced by the spontaneous ignition of hypergolic fuel stored in the CEV SM. The facilities considered included

- Vehicle Assembly Building (VAB)
- Multi-Payload Processing Facility (MPPF)
- Canister Rotation Facility (CRF)

Subsequent discussion deals with the MPPF analysis. Figure 1 provides a view of the MPPF from the northwest. An interior view of the facility is shown in Figure 2. The study was concerned with both blast hazards and hazardous fragments which exceed existing safety standards, as described in Section 2.0. The analysis included both blast and fragmentation effects and was divided into three parts as follows:

- blast
- primary fragmentation
- secondary fragmentation

Blast effects are summarized in Section 3.0, primary fragmentation in Section 4.0, and secondary fragmentation (internal and external) in Section 5.0. Conclusions are provided in Section 6.0, while references cited are included in Section 7.0. A more detailed description of the entire study is available in a separate document [1]. The study conformed to certain guidelines specified by NASA/KSC [2].

---

\* Numbers in brackets refer to references cited as presented in Section 7.0.



Figure 1. Multi-Payload Processing Facility (MPPF)

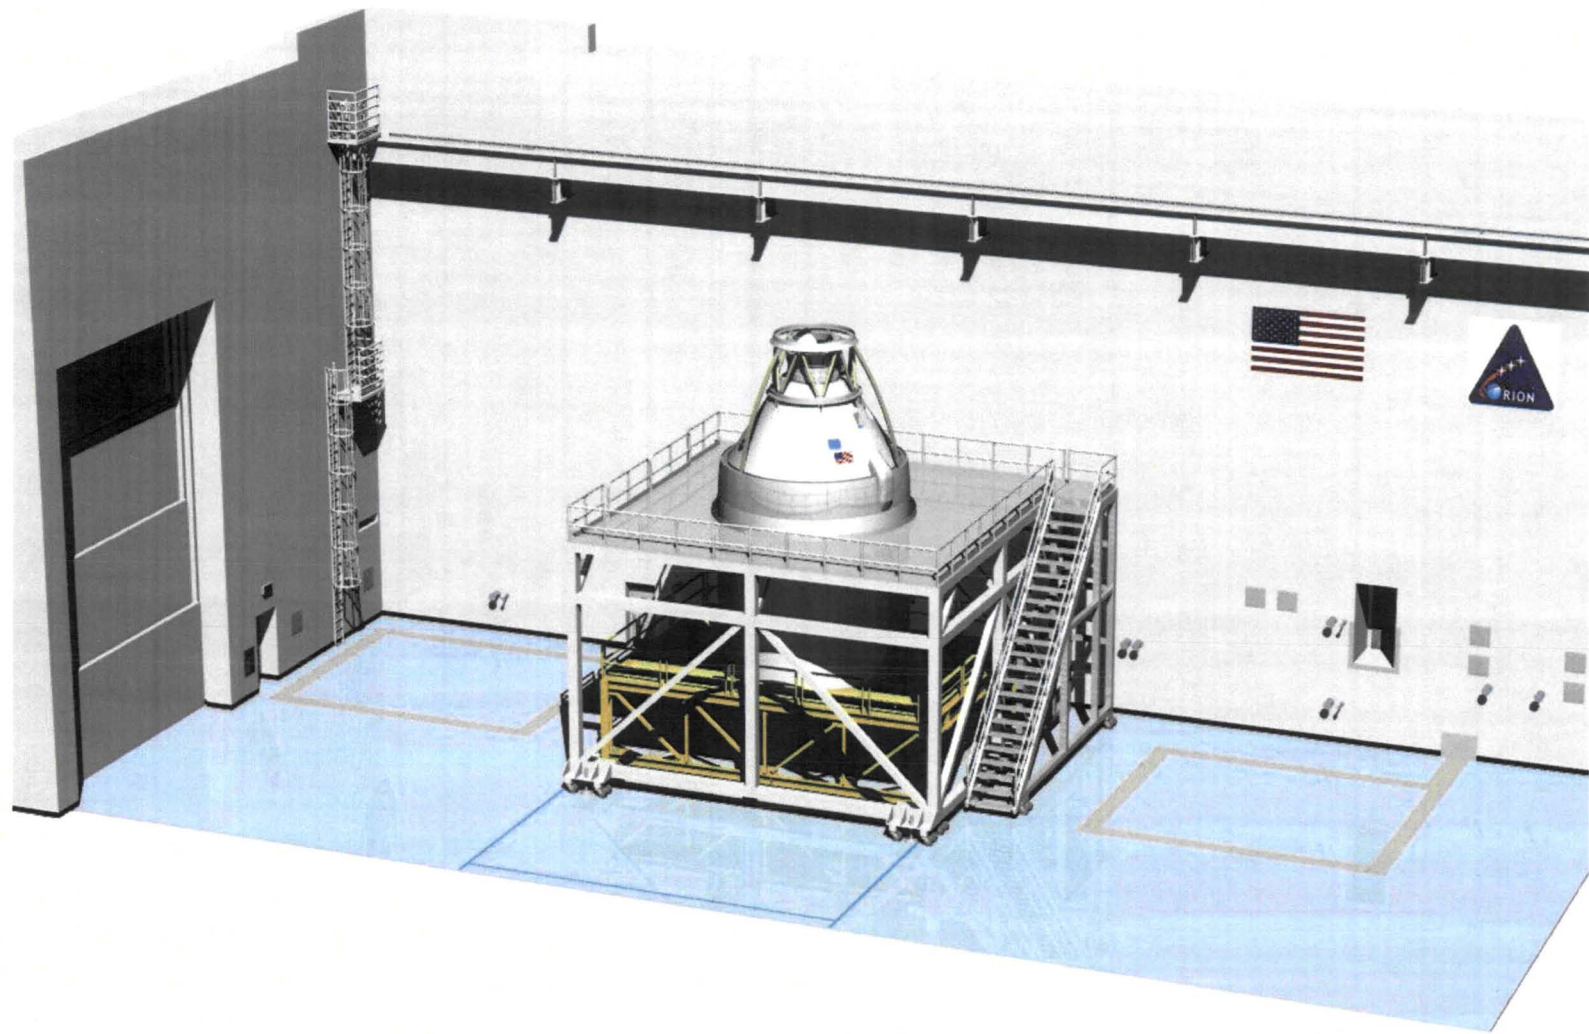


Figure 2. CEV 606 Short Stack Surrounded By Access Stand Positioned Within MPPF Highbay



## 2.0 SAFETY STANDARDS

Relevant safety standards [3 - 6] specify overpressure limits for inhabited buildings from 0.9 to 1.2 psi. Likewise, for fragmentation hazards, fragment impact energies in excess of 58 ft-lb<sub>f</sub>, in number densities greater than 1 per 600 square feet, (as measured in a vertical plane one foot wide extending from ground level up to an elevation of 6 feet) are considered hazardous. For a building containing explosives with a TNT equivalence on the order of 1000 lb<sub>m</sub>, the inhabited building distance is 1250 feet from the perimeter of the building. Figure 3 provides a plan view of the explosive safety arc and nearby KSC structures.

## 3.0 BLAST EFFECTS

The hypergolic fuel contained within the CEV Service Module with a total mass (including 20% design growth margin) of 21,591 lbs, was assumed to detonate with an equivalent yield of 1080 lbs of TNT. The CEV was positioned in the Access Stand within the MPPF high bay, as shown in Figure 4. All relevant components of the MPPF, both internal and external, were included in the analysis, along with all significant surrounding structures within a range of 1250 feet, or slightly further, from the MPPF. Blast effects were computed by means of the HEXDAM software [7]. Five views of the undamaged MPPF structure, as generated by HEXDAM, are presented in Figures 5 through 9. The corresponding five views of the MPPF with blast damage are presented in Figures 10 through 15. As indicated in these last five figures, severe blast damage was predicted to much of the roof, as well as all four faces of the MPPF.

With regard to overpressure predictions, both 0.9 and 1.2 psi horizontal contour plots were generated at eight different elevations, ranging from 0 to 70 feet. The maximum ranges for such contours occurred at 50 feet, as shown in Figure 16. As indicated in this figure, the 1.2 psi overpressure contour extended out no more than 355 feet from the MPPF perimeter while the 0.9 psi overpressure contour extended out no more than 436 feet. The results indicated significant hazard to the MPPF itself but no significant hazards to the surrounding buildings would result from blast effects. A summary of blast hazards is provided in Table 1.

Table 1. Summary of MPPF Blast Hazards

<u>FACILITY #/NAME</u>	<u>HAZARDS</u>
M7-1104/MPPF High Bay	Moderate-to-Severe
M7-1104/MPPF North Office	None-to-Severe
M7-1104/MPPF Low Bay	None-to-Severe
M7-1104/MPPF Flight Data Control Room	Slight-to-Severe
M7-1104/MPPF Annex	None-to-Severe
M7-1357/Multi Operations Support Bldg (MOSB)	None-to-Slight
M7-1354/Payload Hazardous Servicing Facility (PHSF) Bldg	None-to-Slight
M7-1355/PHSF Storage Bay	None-to-Slight
M7-1059/Hypergolic Maintenance Facility	None-to-Slight
M7-0777/Canister Rotation Facility - High Bay	None-to-Slight
M7-0777/Canister Rotation Facility - Office Area	None

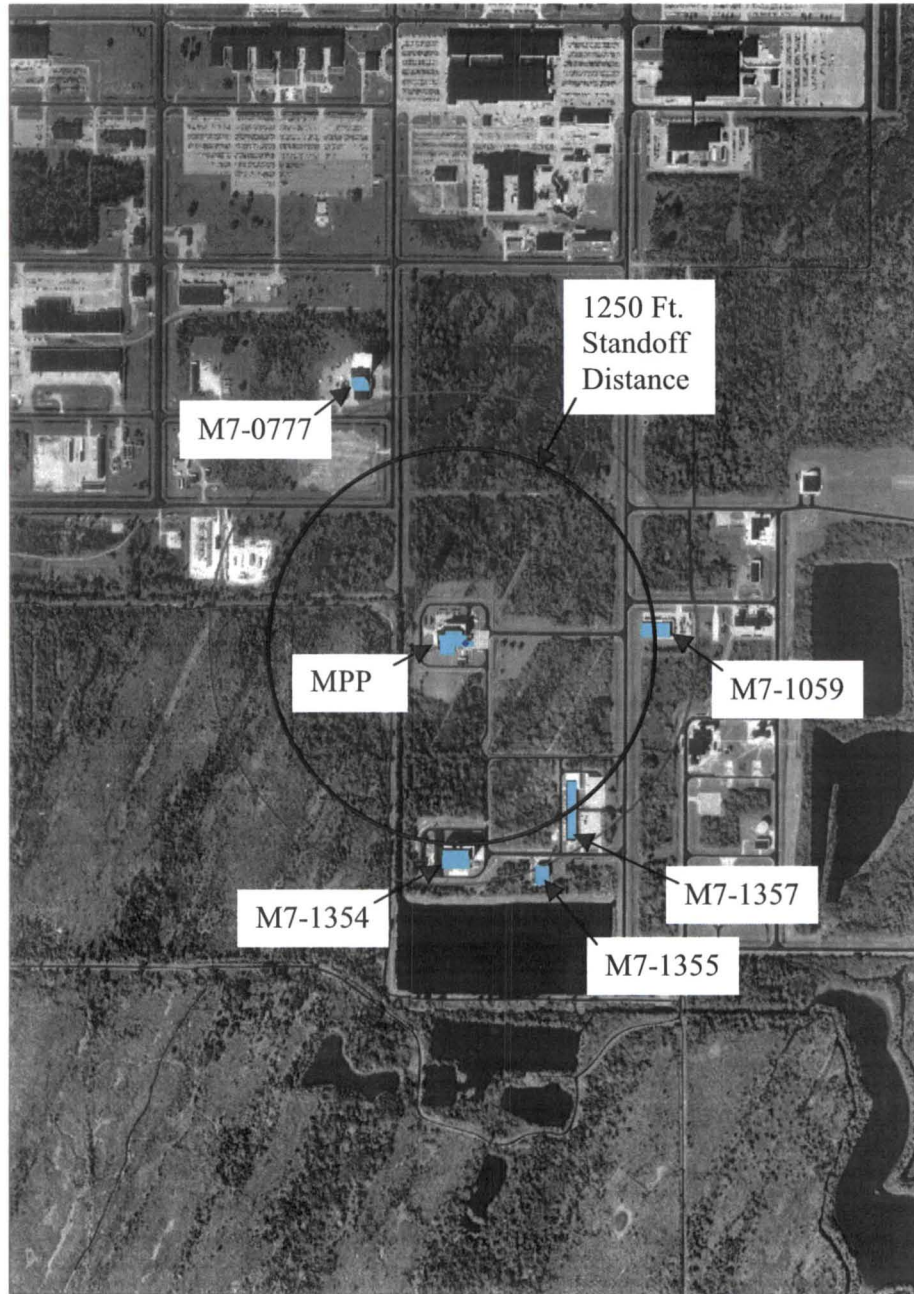


Figure 3. KSC Buildings in Vicinity of MPPF

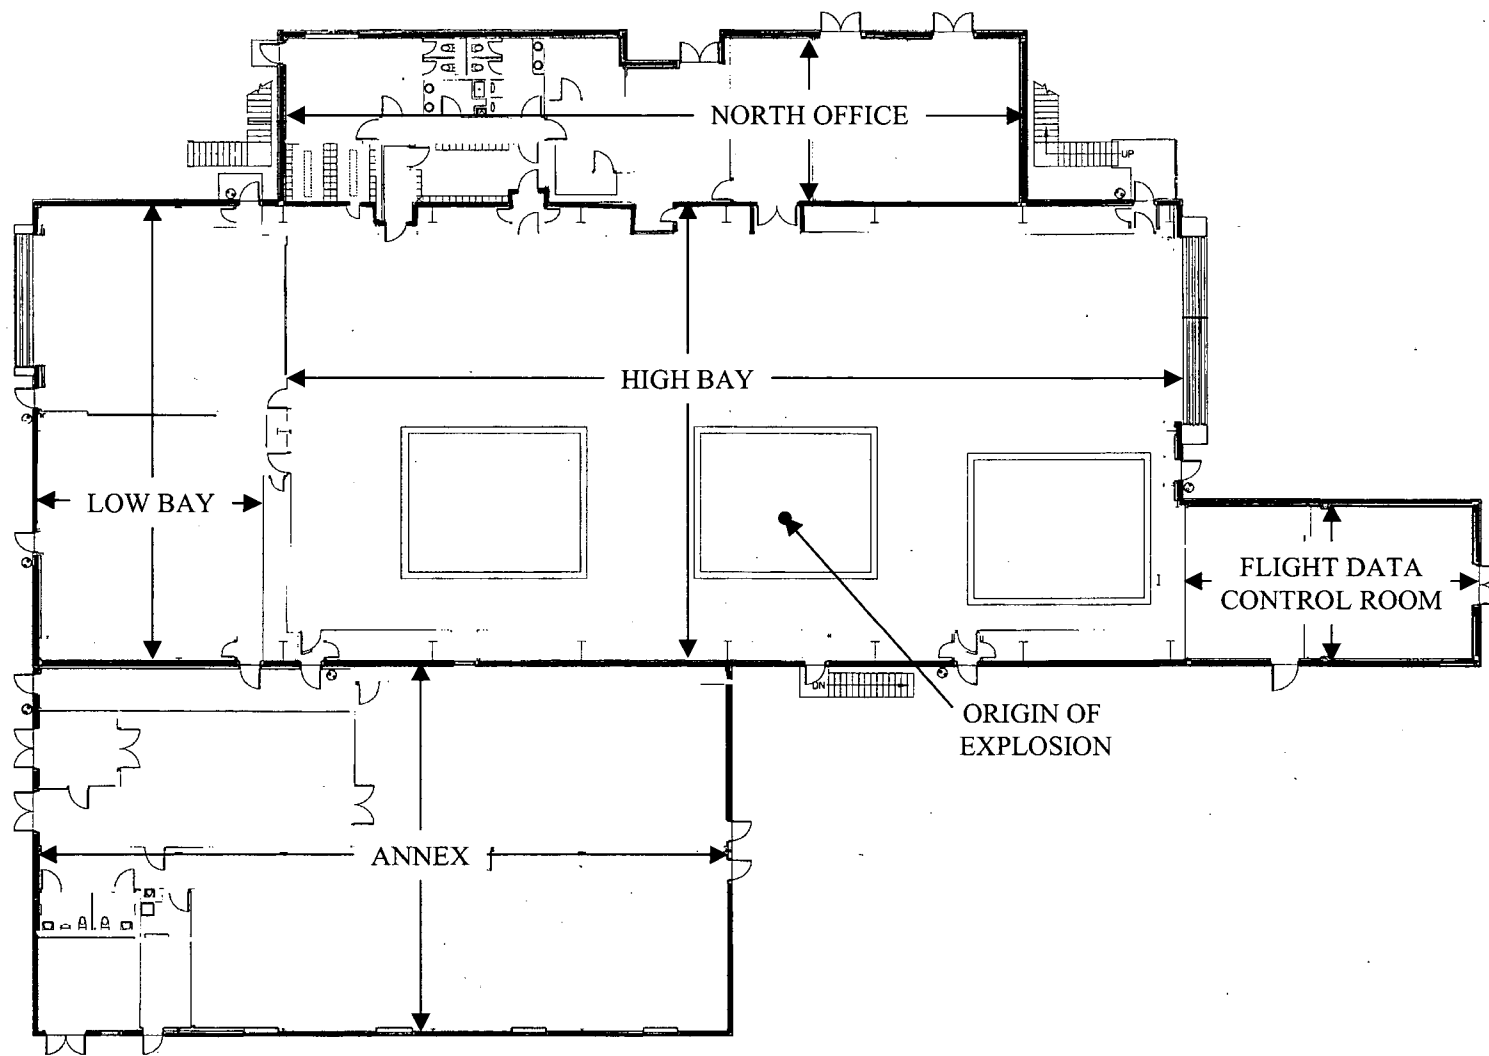


Figure 4. MPPF Plan View

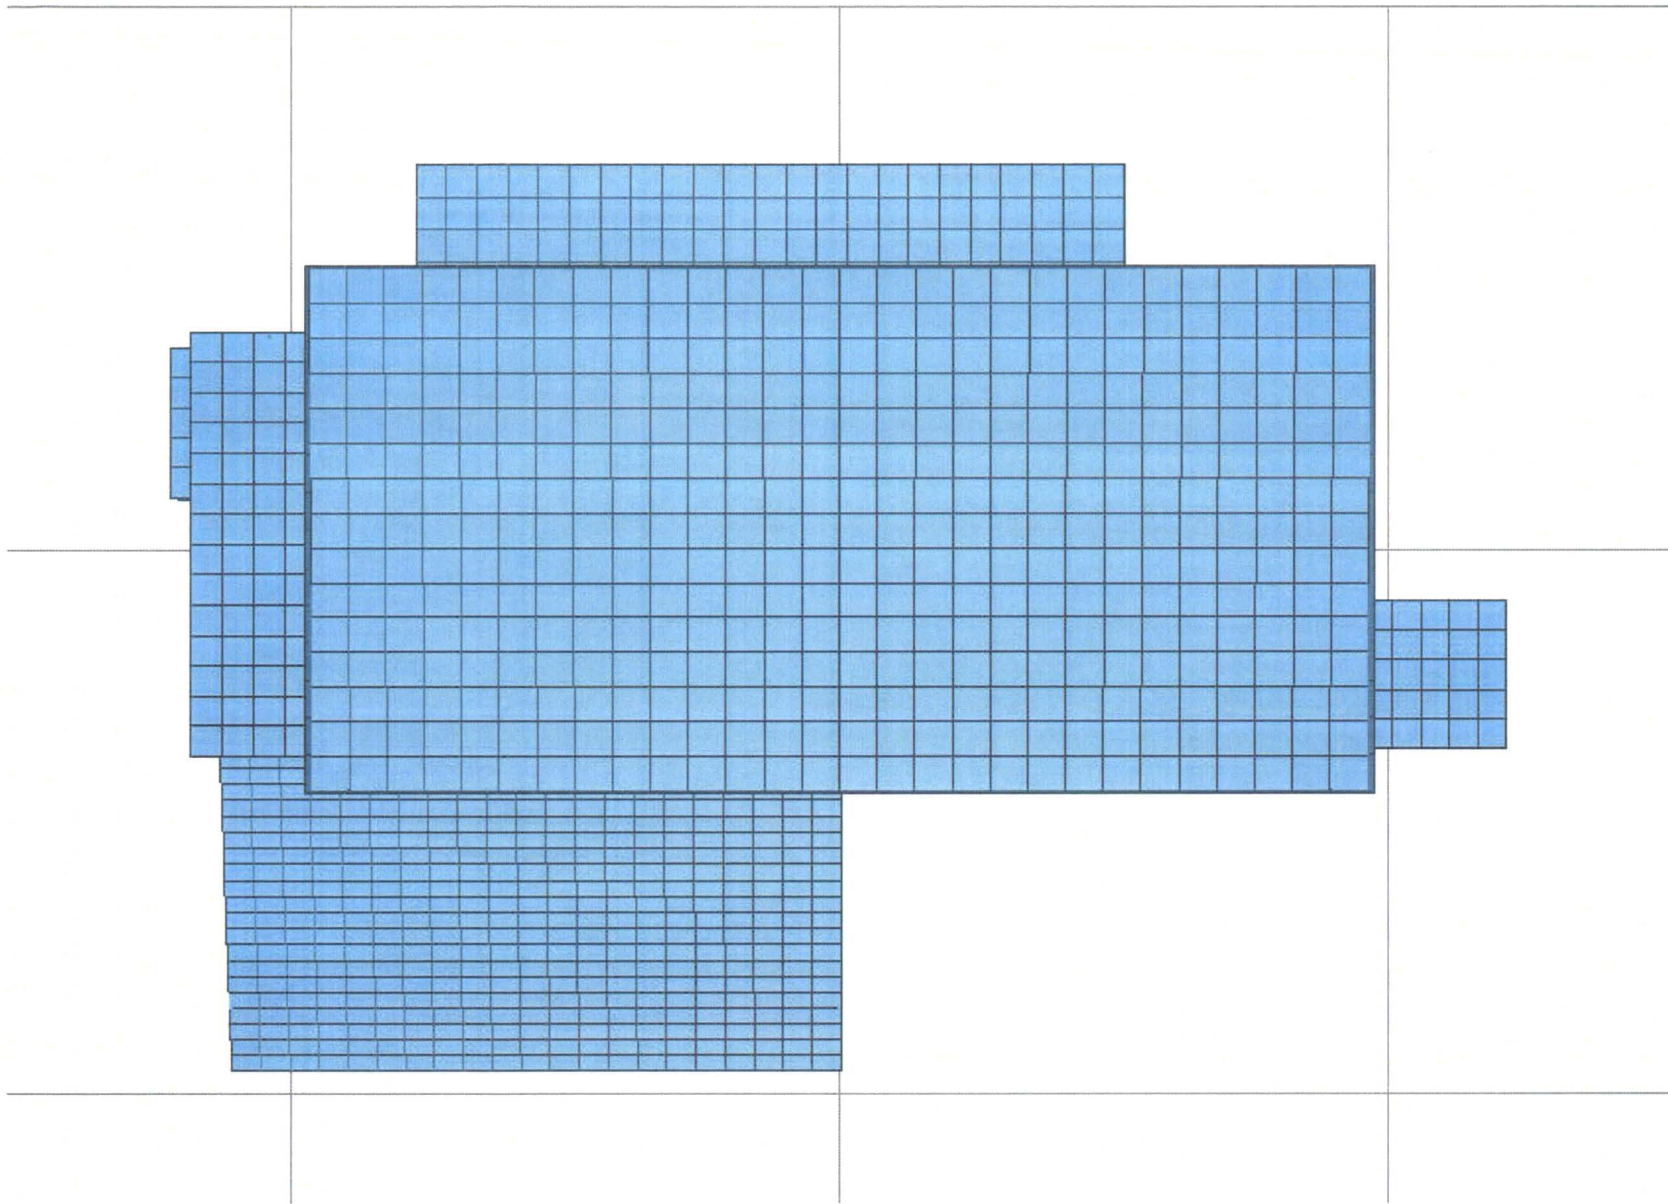


Figure 5. MPPF Roof



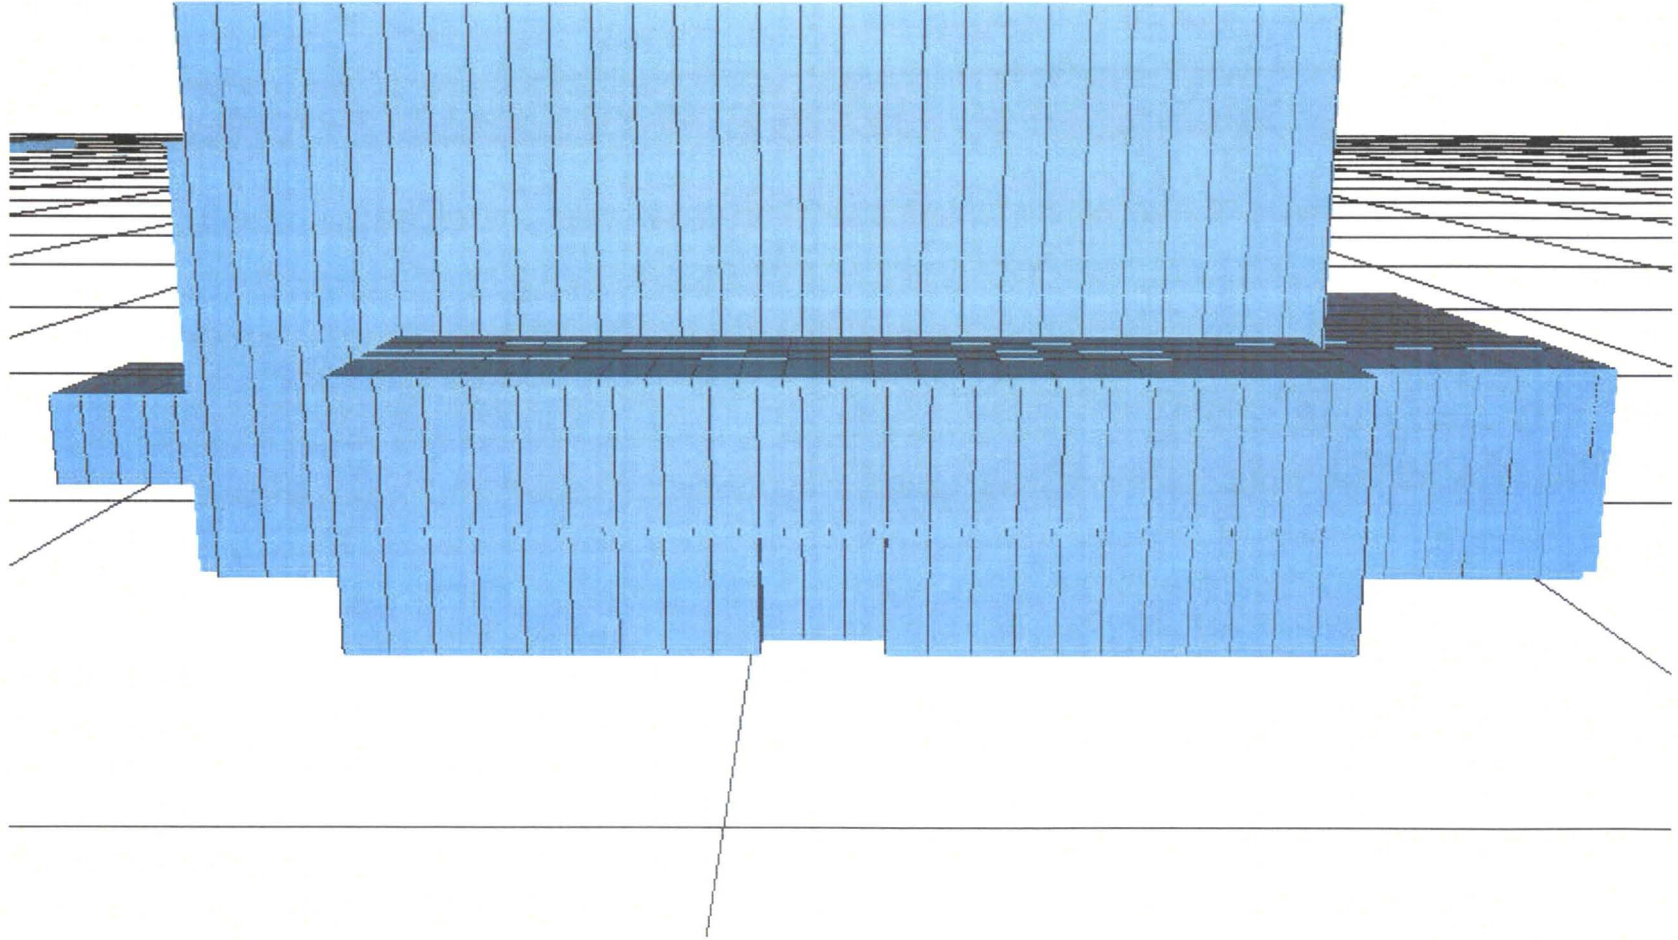


Figure 6. MPPF North Face

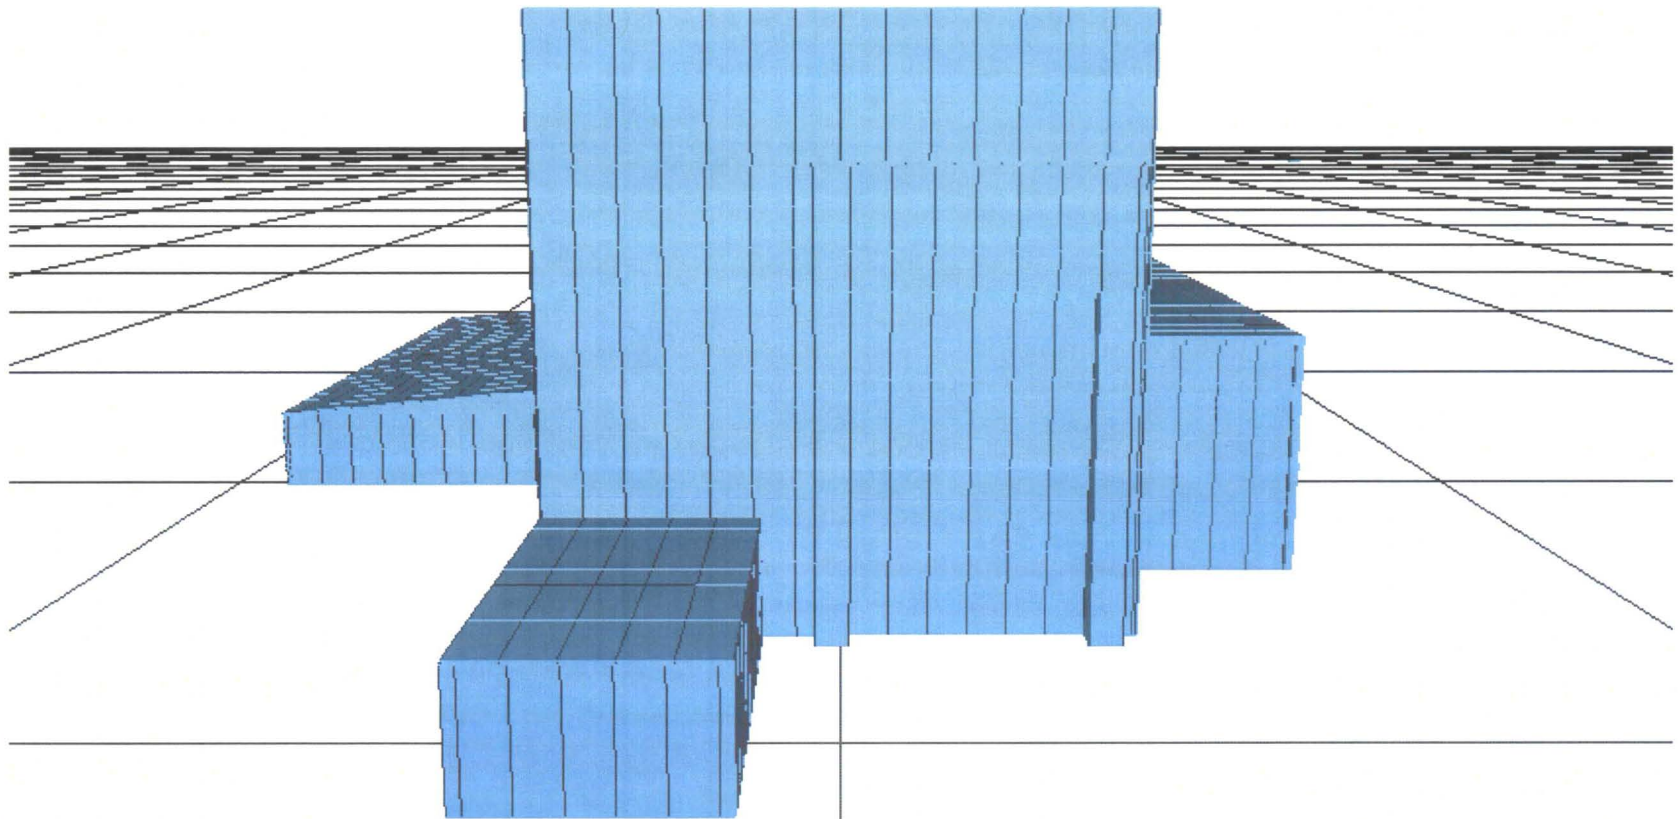


Figure 7. MPPF East Face

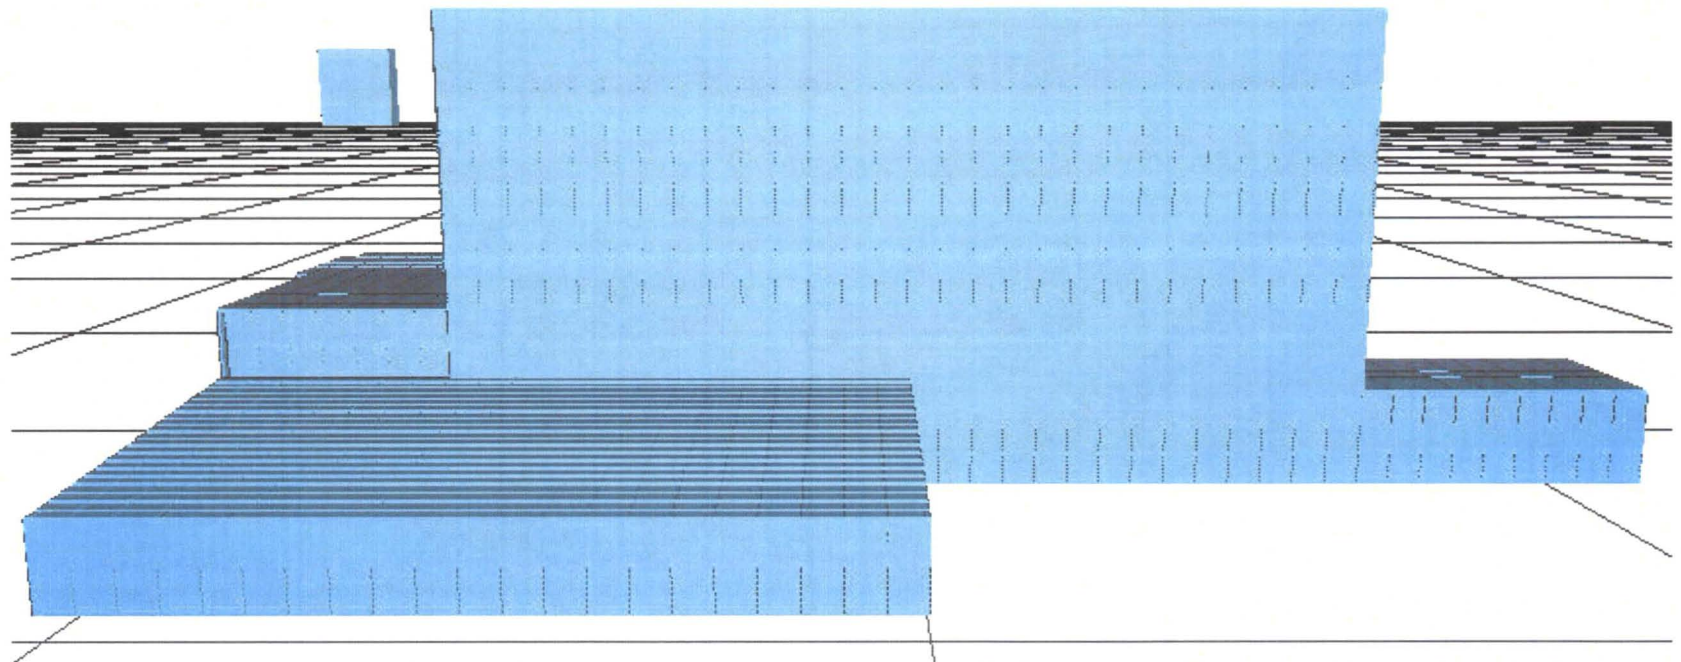


Figure 8. MPPF South Face



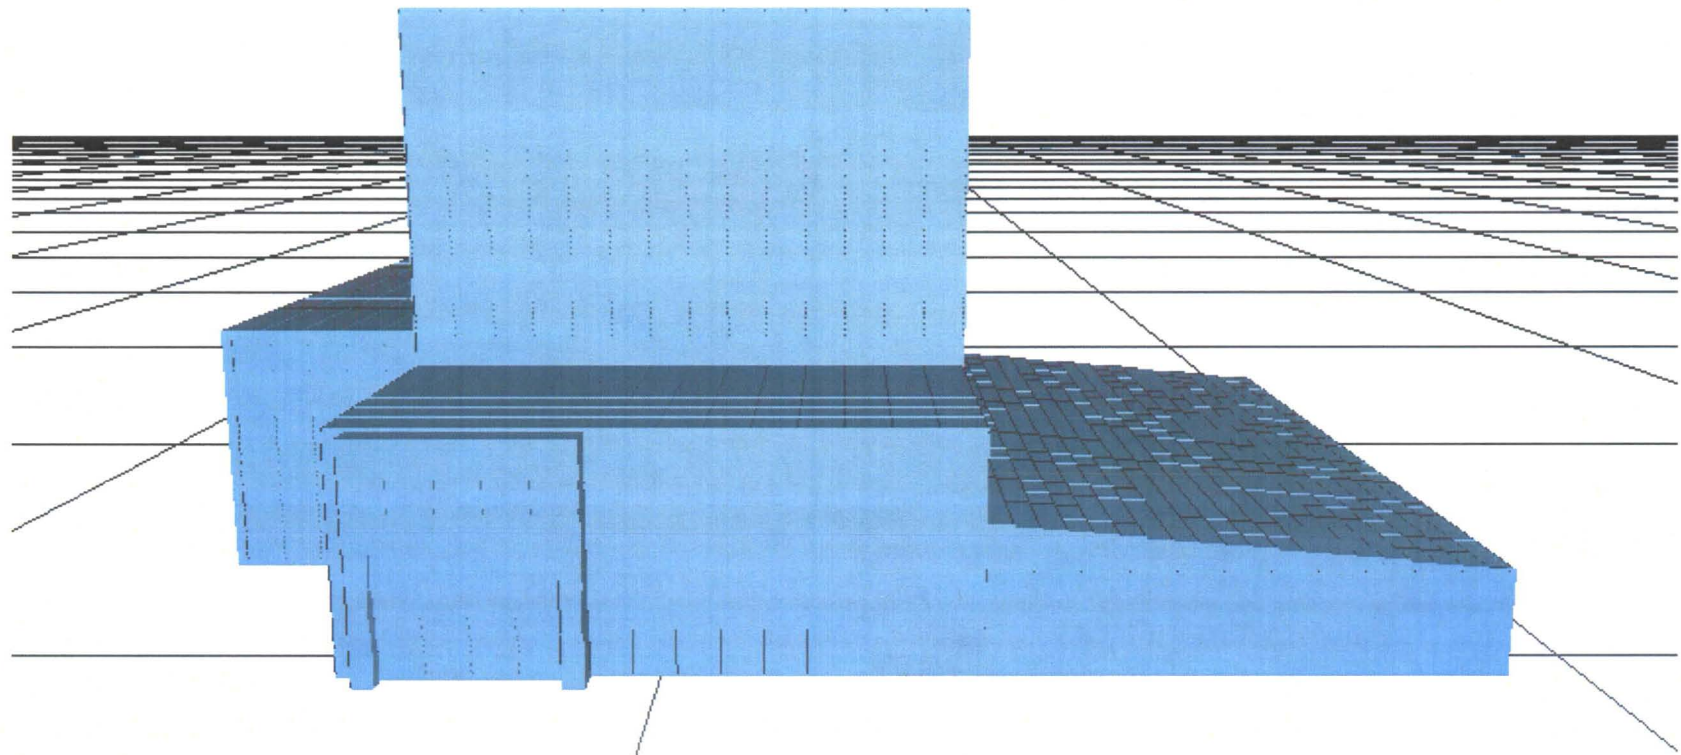


Figure 9. MPPF West Face



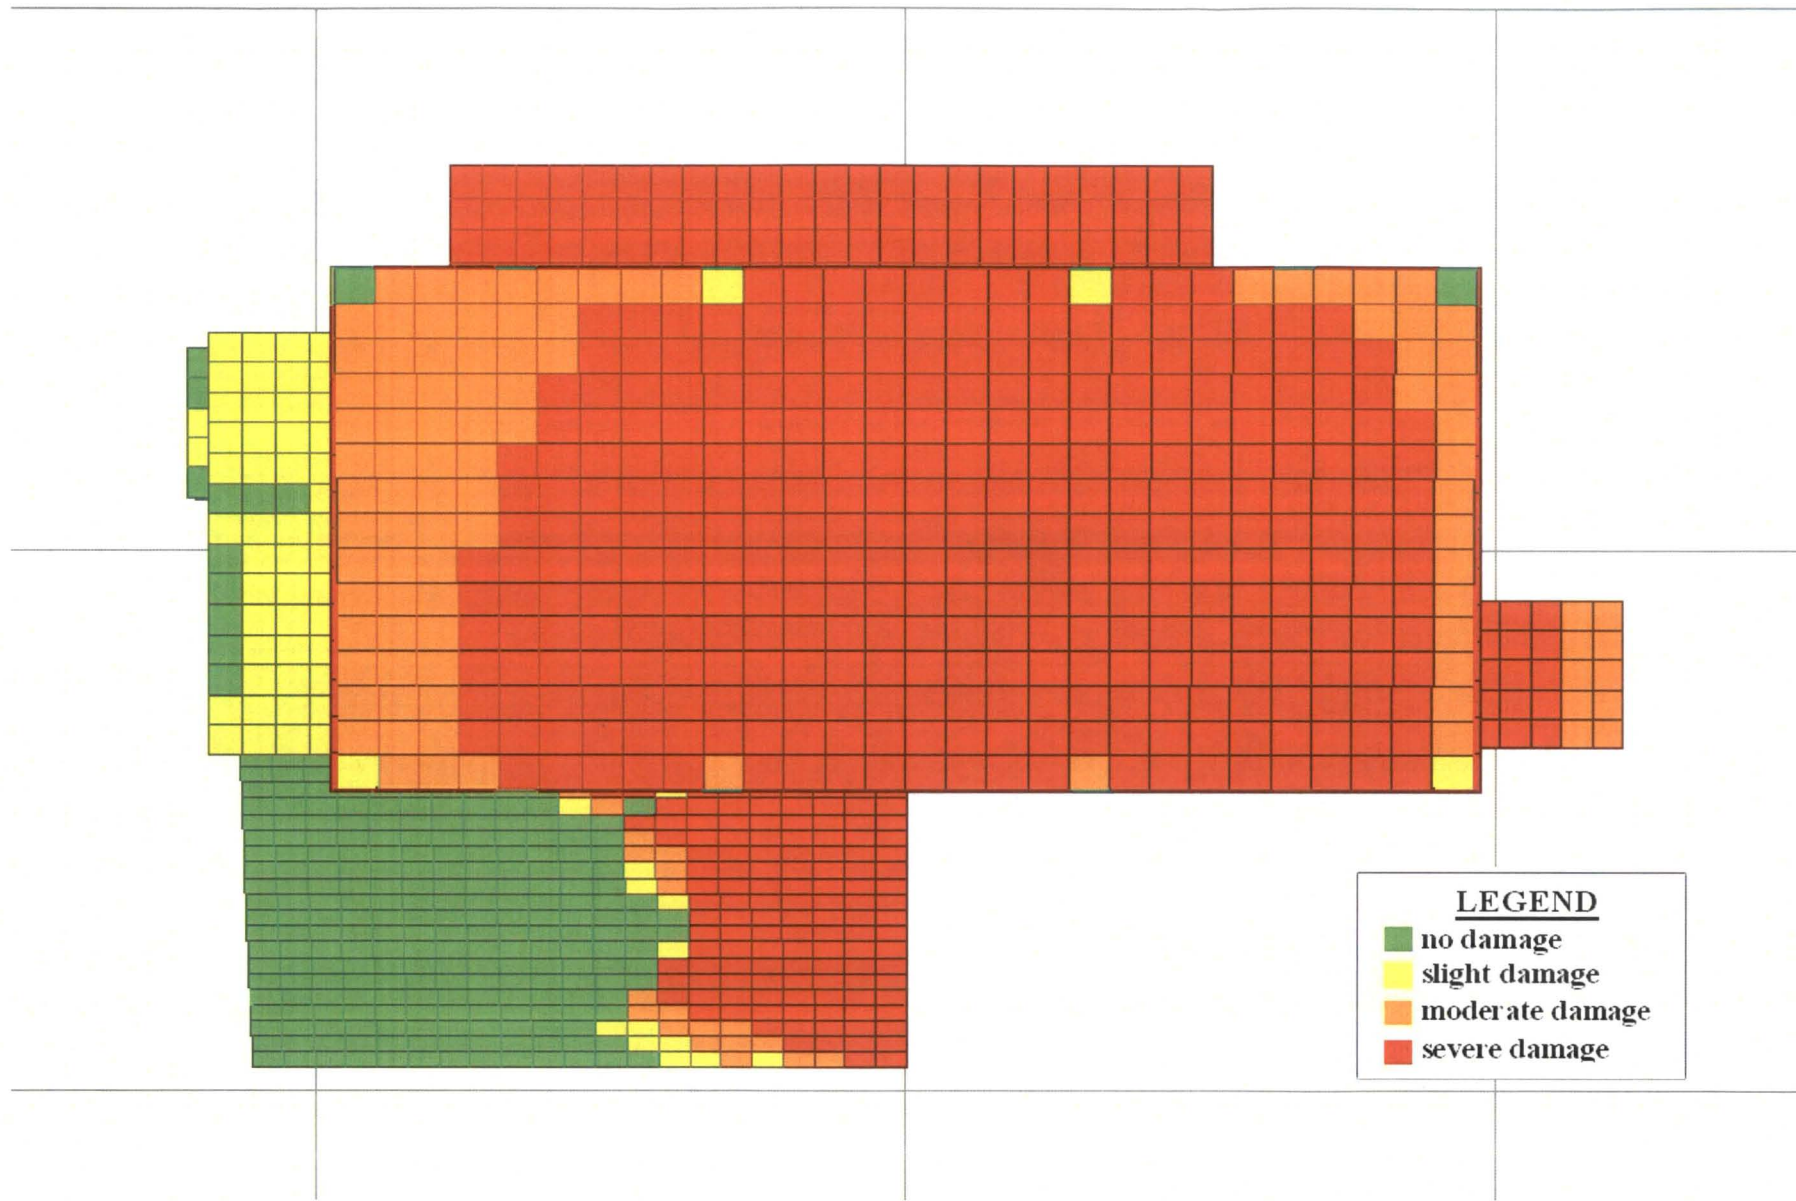


Figure 10. Damage Plot, MPPF Roof

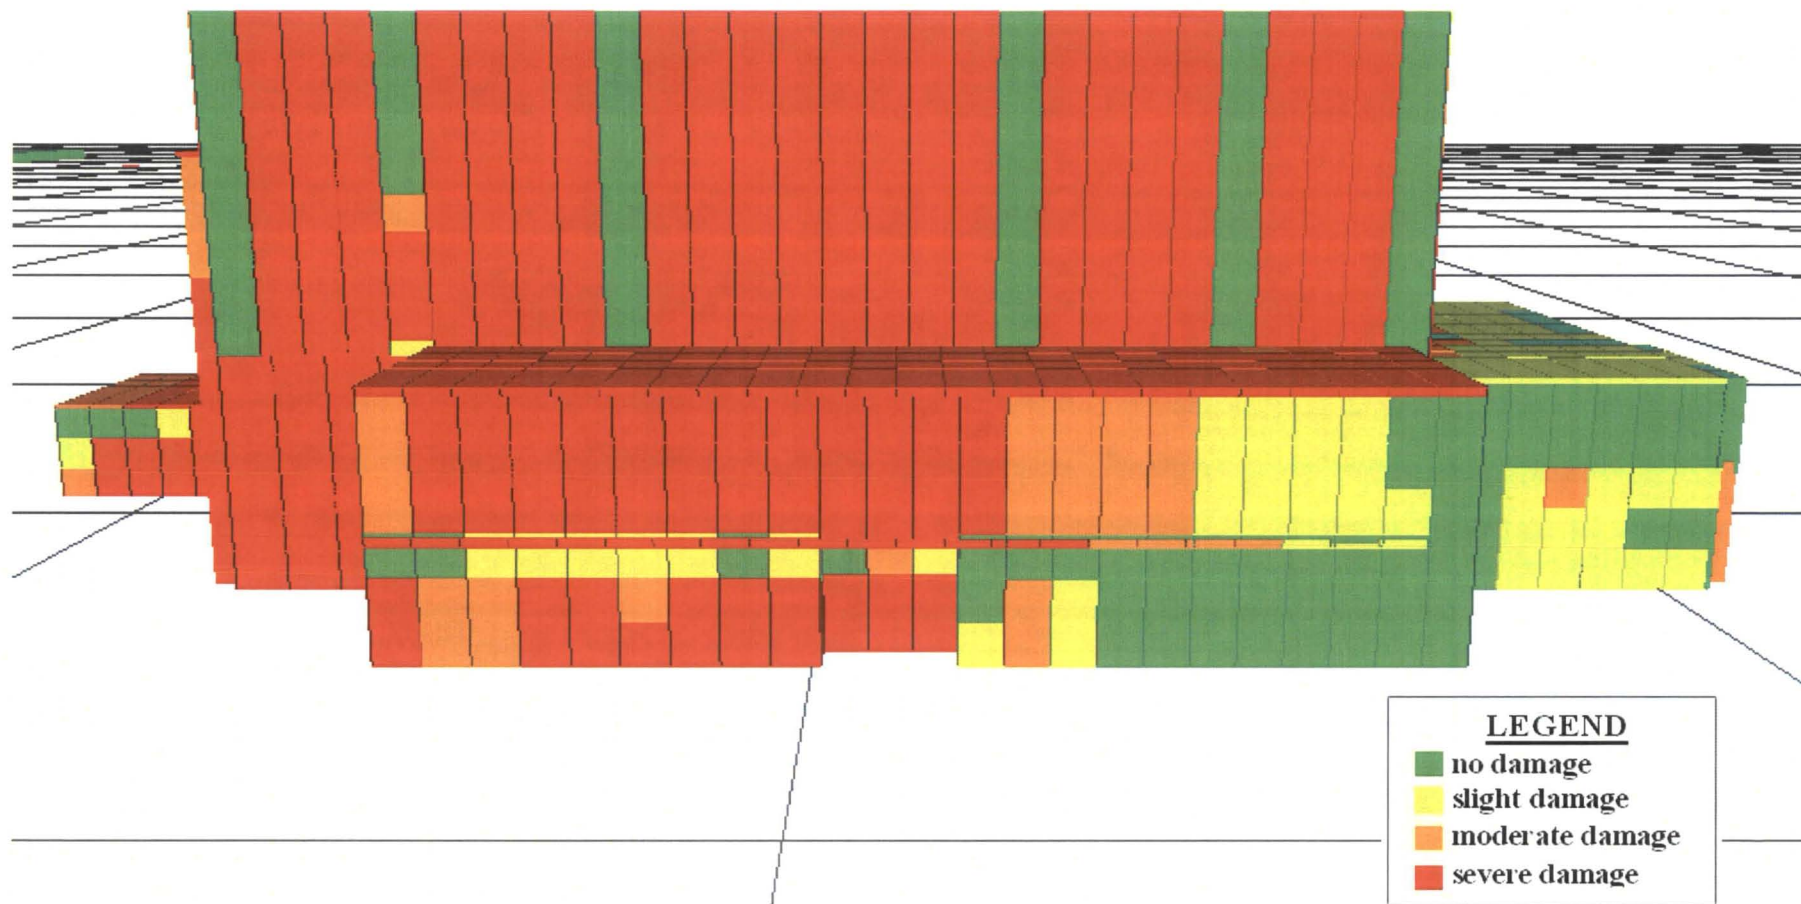


Figure 11. Damage Plot, MPPF North Face

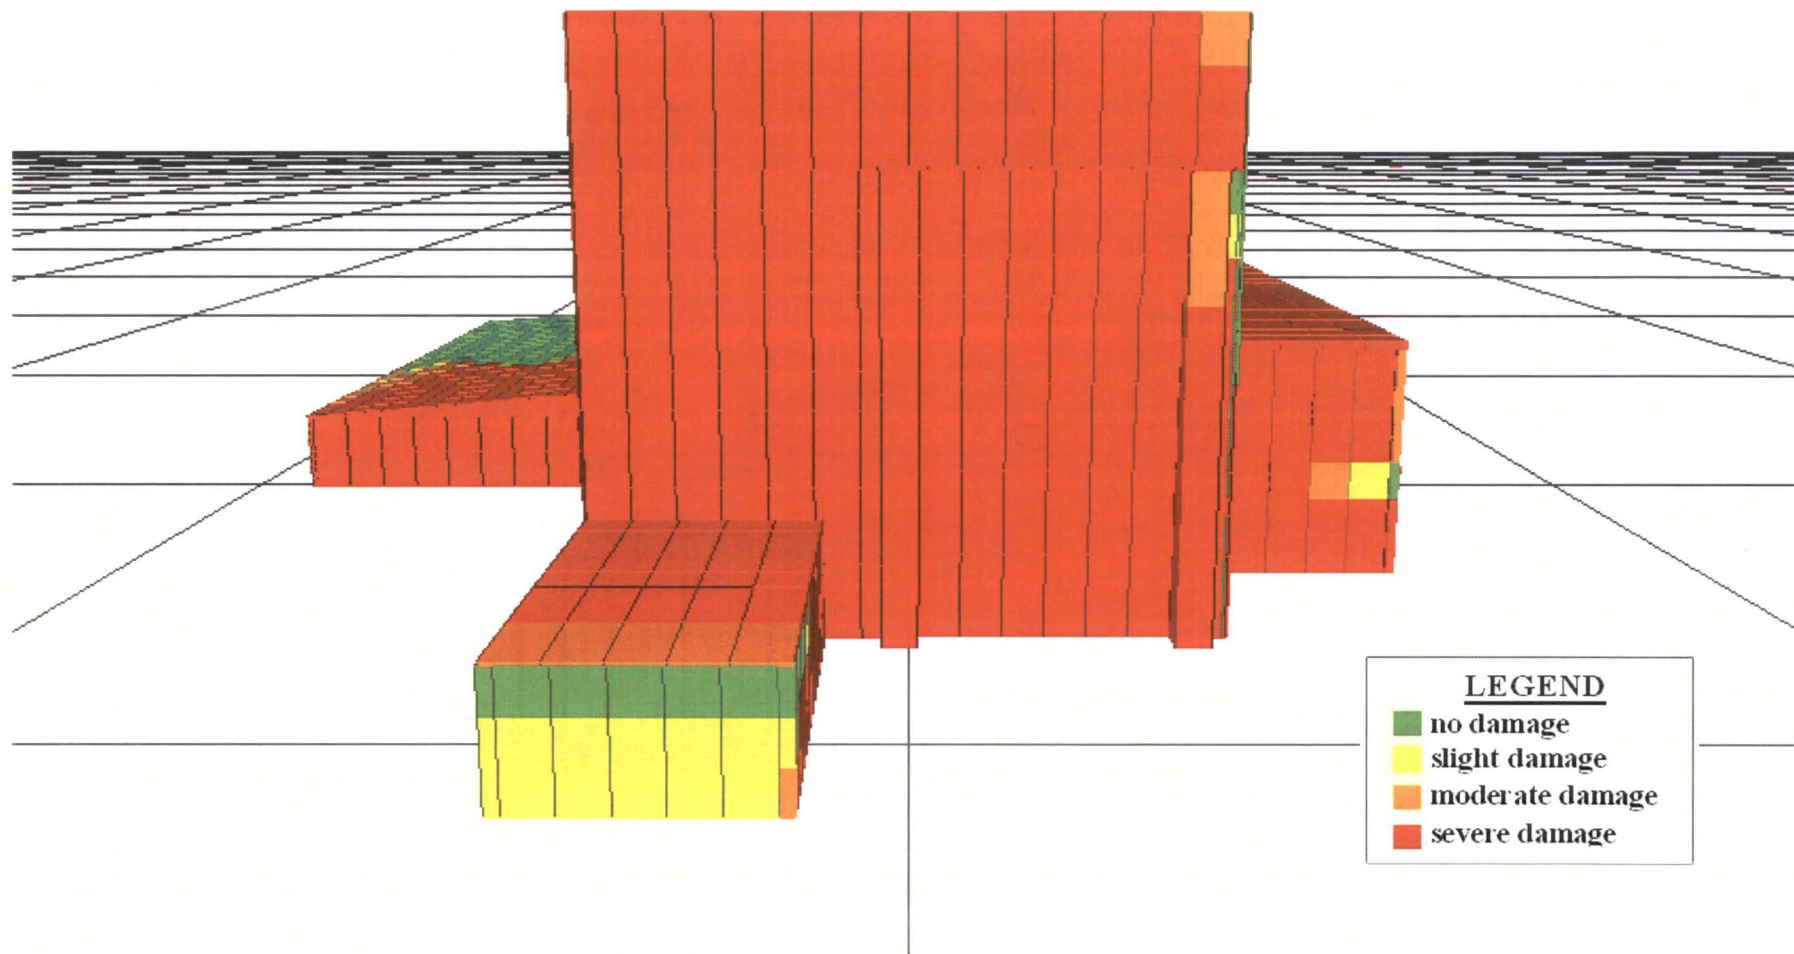


Figure 12. Damage Plot, MPPF East Face



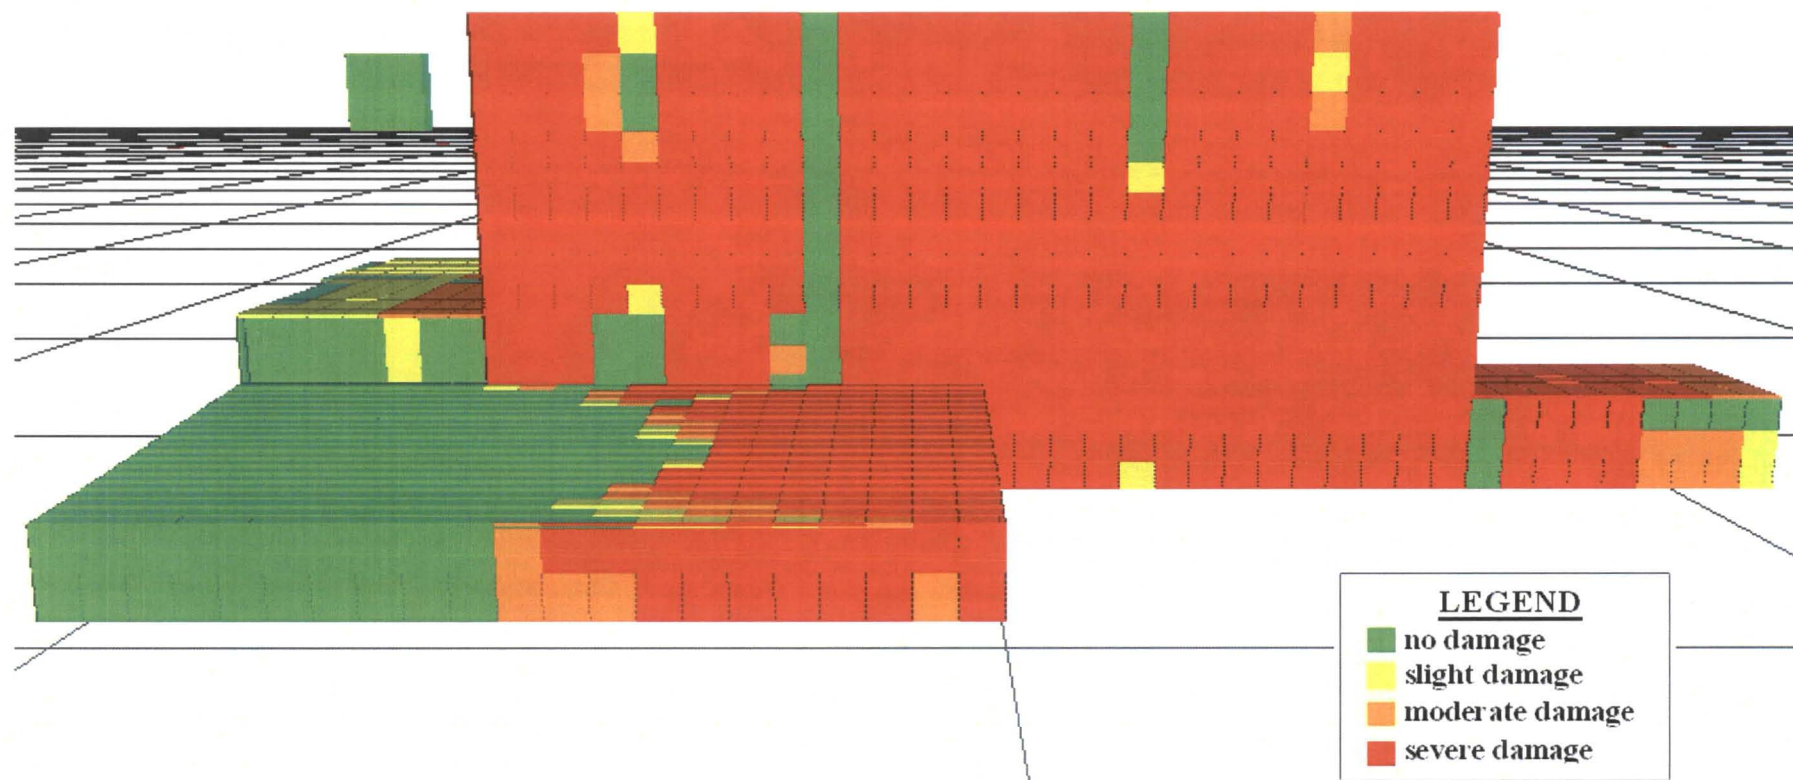


Figure 13. Damage Plot, MPPF South Face



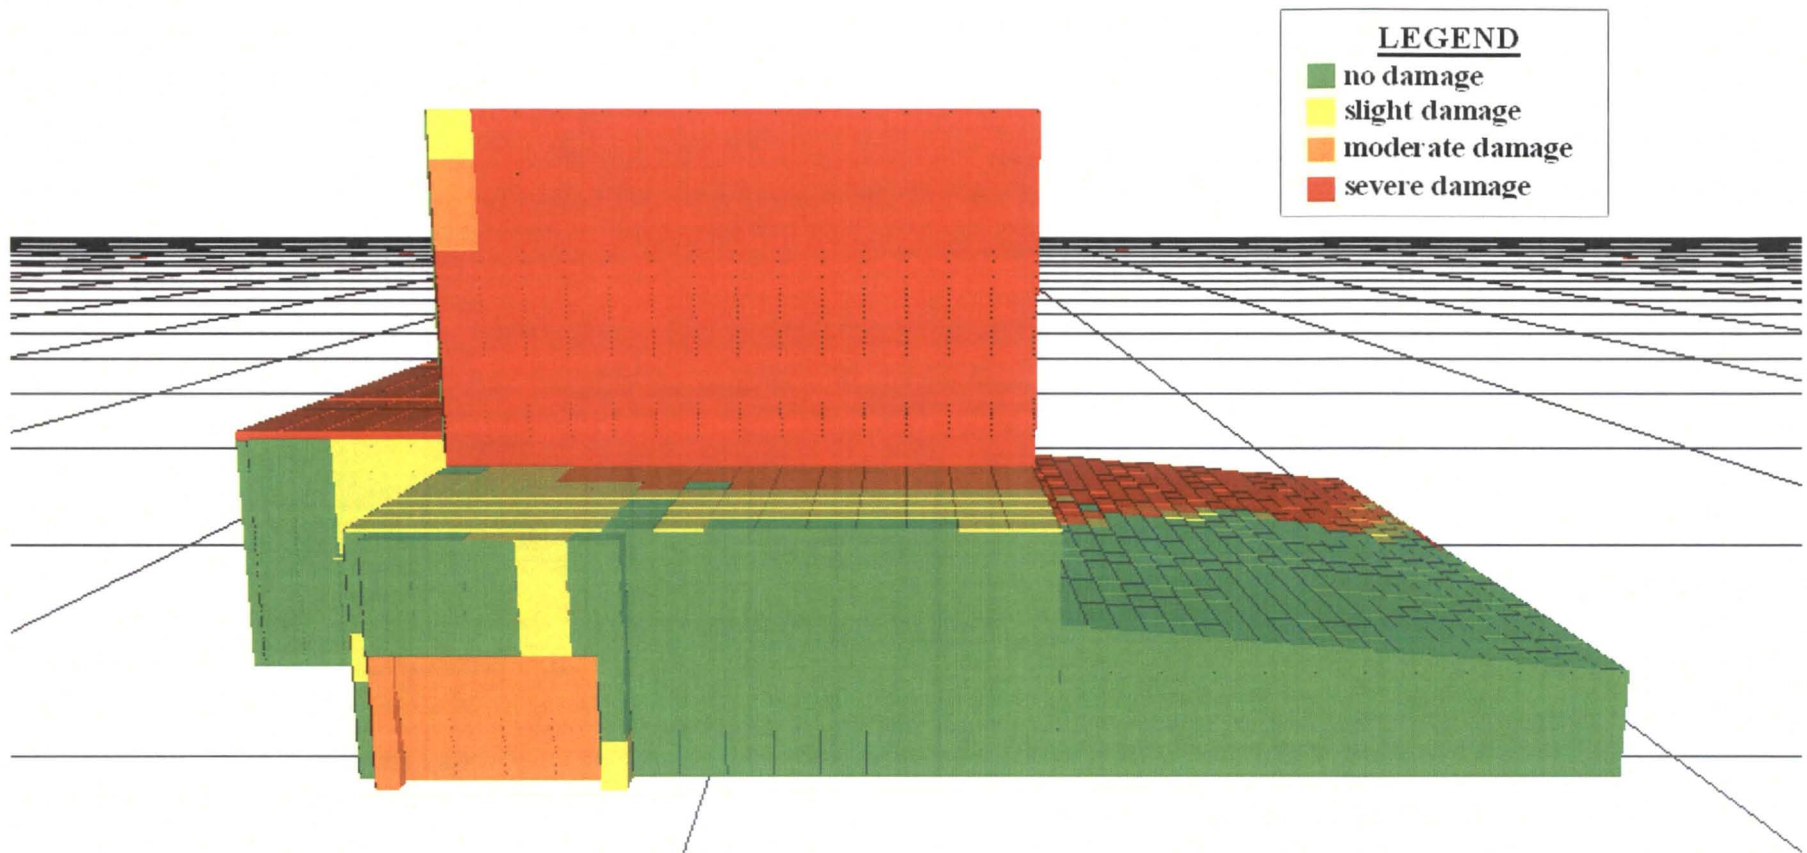


Figure 14. Damage Plot, MPPF West Face

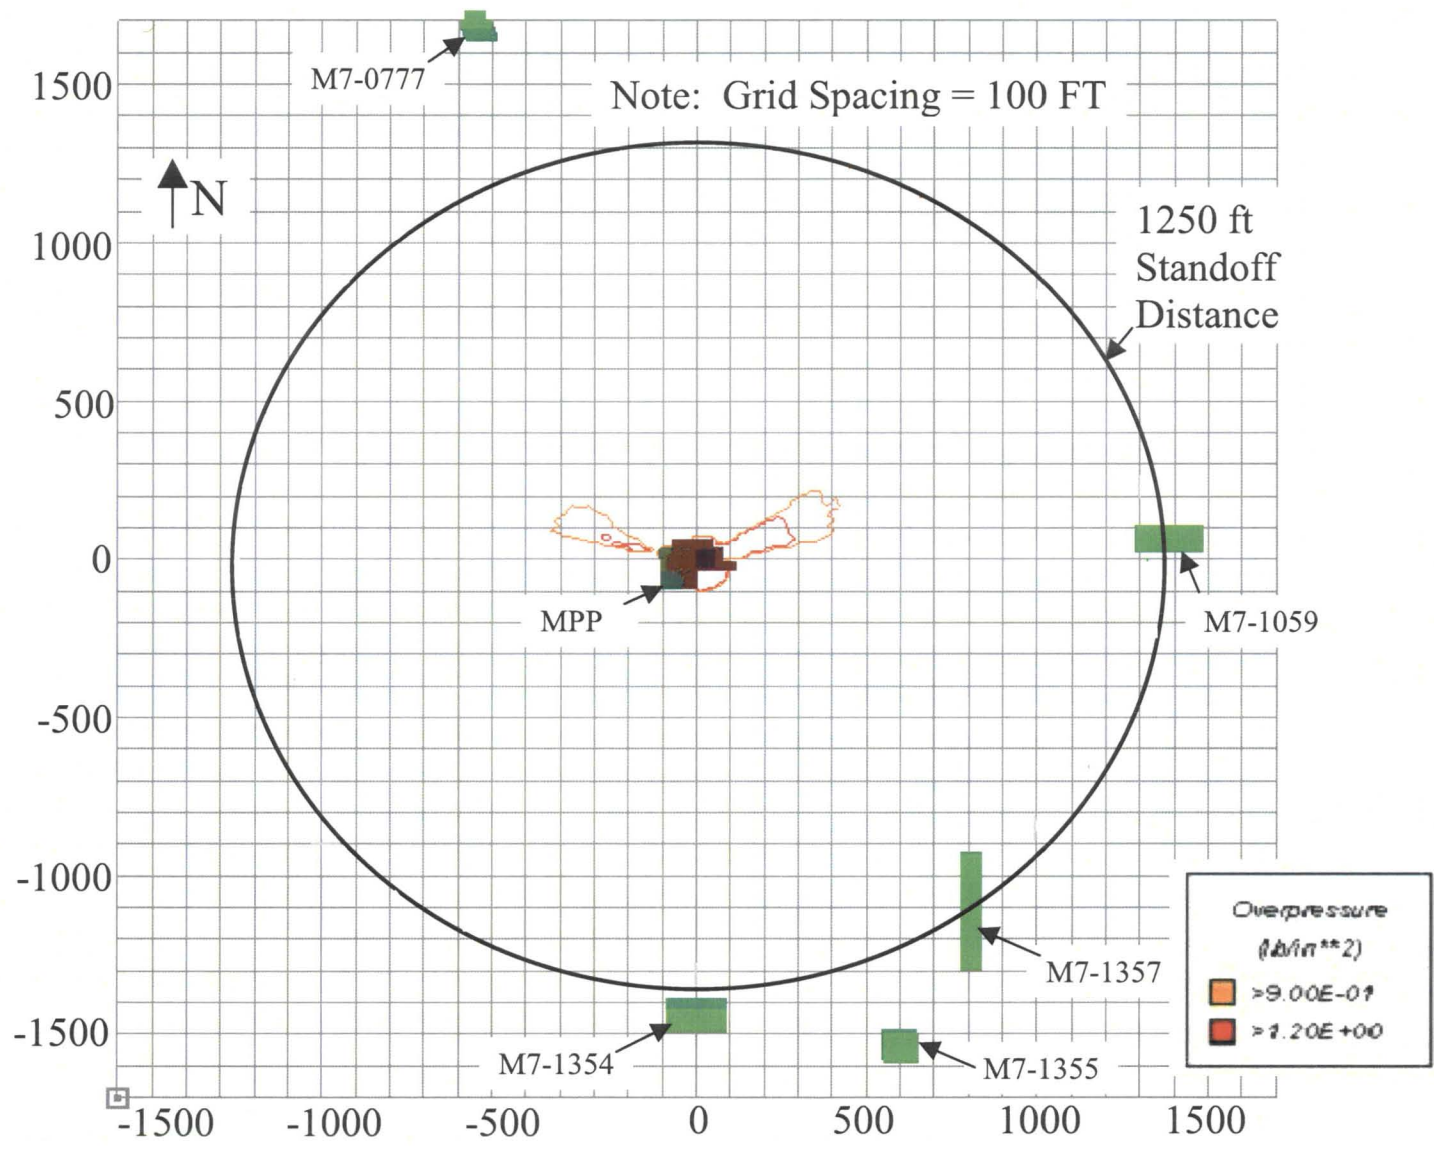


Figure 15. Horizontal Contour Plot, Overpressure (0.9 and 1.2 psi) Elevation 0 Ft.

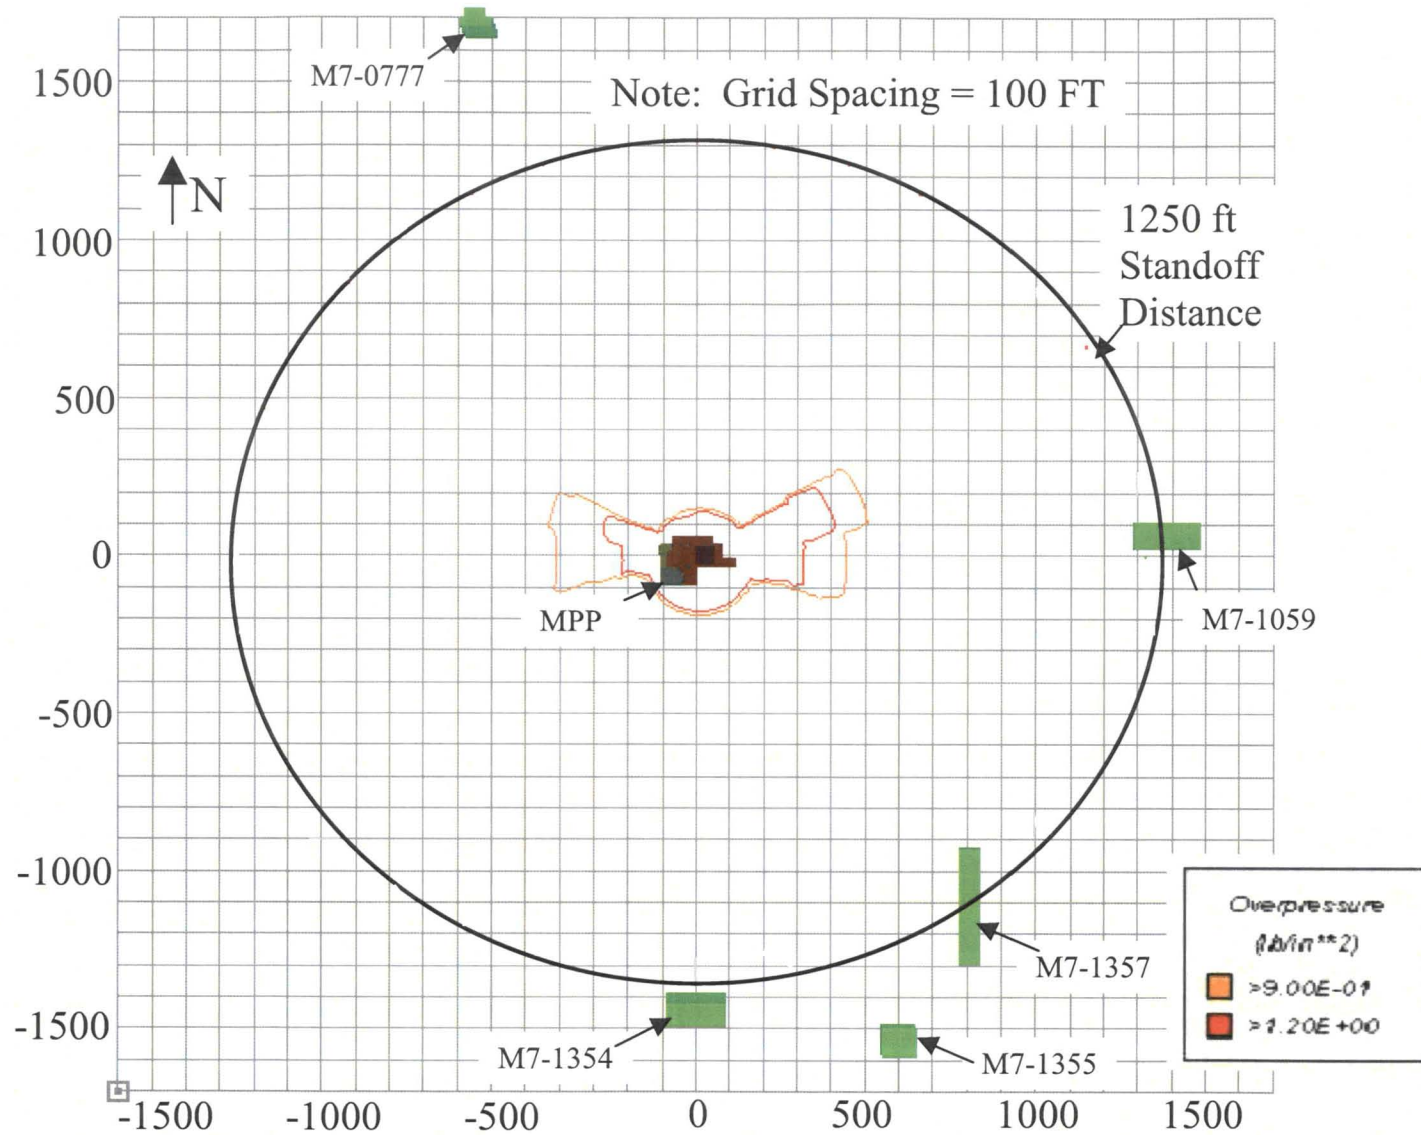


Figure 16. Horizontal Contour Plot, Overpressure (0.9 and 1.2 psi) Elevation 50 Ft.

#### 4.0 PRIMARY FRAGMENTATION

The aluminum components within the CEV Service Module and Spacecraft Adapter were treated as a hollow cylinder which was the source of all primary fragments produced by the explosion. Characteristics of this cylindrical approximation are given in Table 2. Analyses of 88 different fragment paths were carried out by means of the PriFrag software [8]. A fragment drag coefficient of 1.2 was used in this analysis. The results indicated that 19.27% of the fragment paths were blocked by MPPF internal structures but the remaining primary fragments would impact and penetrate the MPPF wall at an elevation of approximately 18 feet. Such primary fragments were characterized by impact energies and number densities (as measured in a one-foot wide vertical plane extending from ground level up to an elevation of 6 feet), which remained hazardous at ranges out to 898 feet beyond the MPPF perimeter, as shown in Figure 17. These primary fragments appear to represent the most significant hazard to most surrounding buildings. A summary of primary fragmentation hazards is provided in Table 3.

Table 2. Cylindrical Approximation of CEV 606 Service Module and Space Craft Adapter for Primary Fragmentation

Cylinder Outside Diameter (ft)	18.223
Cylinder Height (ft)	16.8
Cylinder Wall Thickness (ft)	0.0366
Cylinder Composition	Aluminum
Cylinder Mass (lb <sub>m</sub> )	
Spacecraft Adapter	2837.84
Service Module (.65 x 4780)	<u>3107.00</u>
	Total 5944.84

Table 3. Summary of MPPF Primary Fragmentation Hazards

<u>FACILITY #/NAME</u>	<u>HAZARDS</u>
M7-1104/MPPF High Bay	Severe
M7-1104/MPPF North Office	Severe
M7-1104/MPPF Low Bay	Severe
M7-1104/MPPF Flight Data Control Room	Severe
M7-1104/MPPF Annex	Severe
M7-1357/Multi Operations Support Bldg (MOSB)	None-to-Slight
M7-1354/Payload Hazardous Servicing Facility (PHSF) Bldg	None-to-Slight
M7-1355/PHSF Storage Bay	None-to-Slight
M7-1059/Hypergolic Maintenance Facility	None-to-Slight
M7-0777/Canister Rotation Facility - High Bay	None-to-Slight
M7-0777/Canister Rotation Facility - Office Area	None-to-Slight

In carrying out this primary fragmentation analysis a discrepancy in the value of fragment drag coefficient was detected and corrected. This discrepancy resulted from the fact that in certain



standard references [6, 9-14] a value of 0.6 (instead of 1.2) was recommended for primary fragment drag coefficient. This value, however, was based on a nonstandard definition of drag, in which a factor of one-half had been omitted. In two earlier studies of explosions in the MPPF [15, 16] this smaller value had been used, resulting in the prediction of significantly greater hazardous primary fragmentation ranges.

## 5.0 SECONDARY FRAGMENTATION

The secondary (internal) fragments were produced by the interaction of the blast wave inside the MPPF high bay interacting with the CEV Access Stand. The generation of secondary (internal) fragments is very dependent on the composition and configuration of the internal structures within the MPPF High Bay. Because of their proximity to the explosion, secondary (internal) fragments tend to be more energetic than secondary (external) fragments, which tend to be more removed from the explosion. The HEXFRAG software [17] was used to carry out the analysis along the 21 different fragment paths, shown in Figure 18. Along 3 of the paths the secondary (internal) fragments impacting the MPPF wall did not possess hazardous impact energies and could not penetrate the MPPF wall. Fragments along the remaining 18 paths did possess hazardous impact energy, and their impact velocity was sufficient to penetrate the MPPF wall.

The secondary (external) fragments were produced by the interaction of the blast wave with the external frangible components of the MPPF high bay, where moderate or severe damage was produced. For purposes of the secondary (external) fragmentation analysis, the MPPF wall was assumed to consist of a sheet of corrugated steel. The HEXFRAG software was used with this assumption to carry out the analysis along the same 21 fragment paths previously noted. The results from the HEXFRAG runs for the secondary (internal) fragments were combined with the secondary (external) fragment results to obtain the total secondary fragment hazardous ranges. As shown in Figure 19, such ranges extended out no more than 420 feet beyond the MPPF perimeter. Such fragments appear to pose a significant hazard to the MPPF itself but no hazard to any nearby KSC structures. A summary of secondary fragmentation hazards is provided in Table 4.

Table 4. Summary of MPPF Secondary Fragmentation Hazards

FACILITY #/NAME	HAZARDS
M7-1104/MPPF High Bay	Severe
M7-1104/MPPF North Office	Moderate-to-Severe
M7-1104/MPPF Low Bay	Moderate-to-Severe
M7-1104/MPPF Flight Data Control Room	Moderate-to-Severe
M7-1104/MPPF Annex	Moderate-to-Severe
M7-1357/Multi Operations Support Bldg (MOSB)	None
M7-1354/Payload Hazardous Servicing Facility (PHSF) Bldg	None
M7-1355/PHSF Storage Bay	None
M7-1059/Hypergolic Maintenance Facility	None
M7-0777/Canister Rotation Facility - High Bay	None
M7-0777/Canister Rotation Facility - Office Area	None

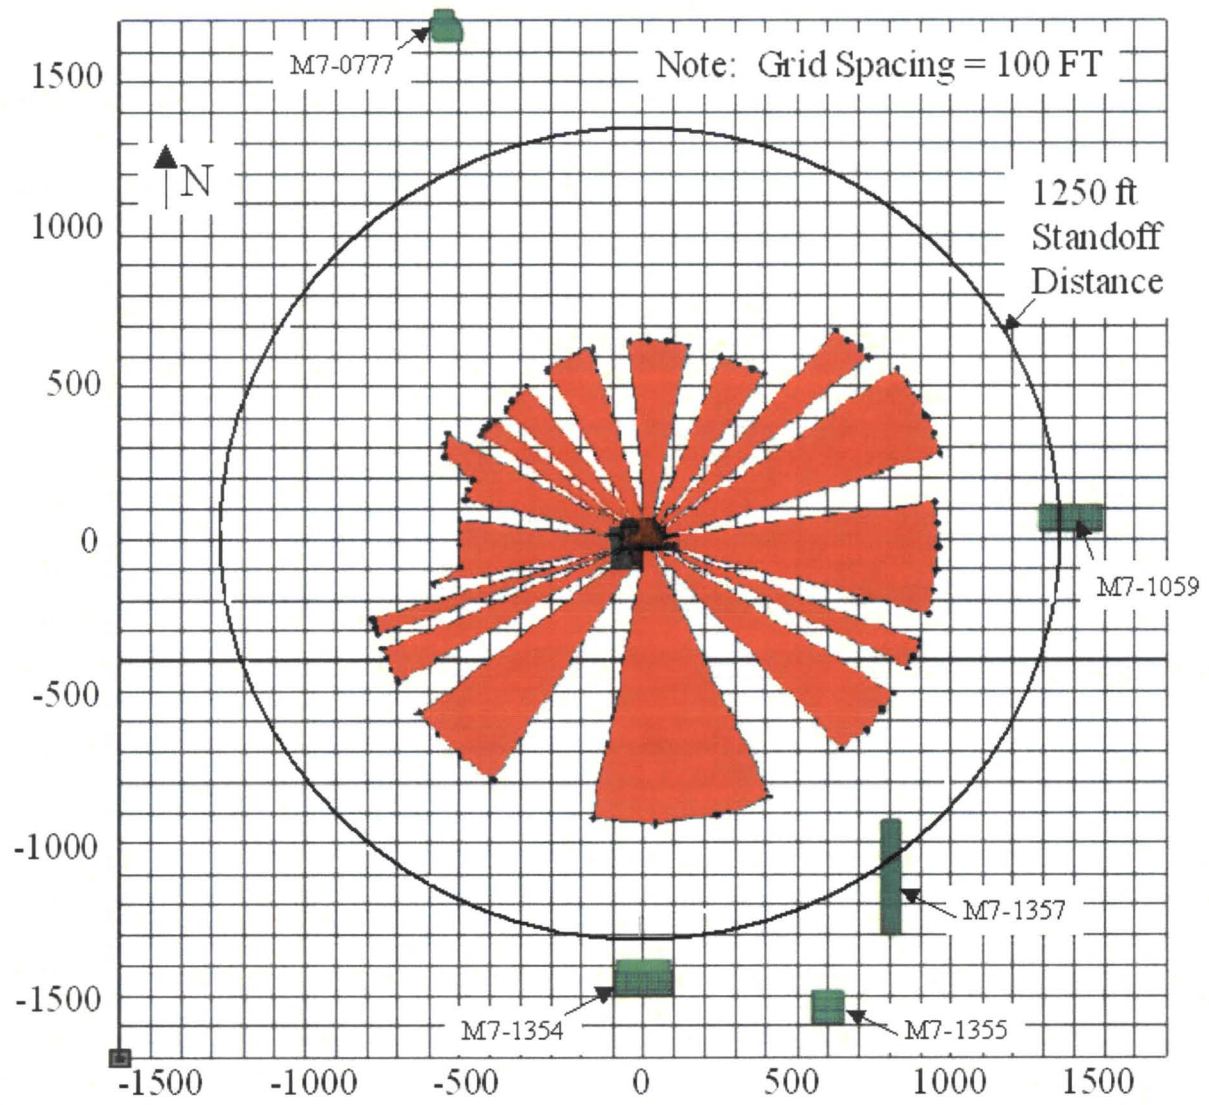


Figure 17. Primary Hazardous Fragment Range Distribution

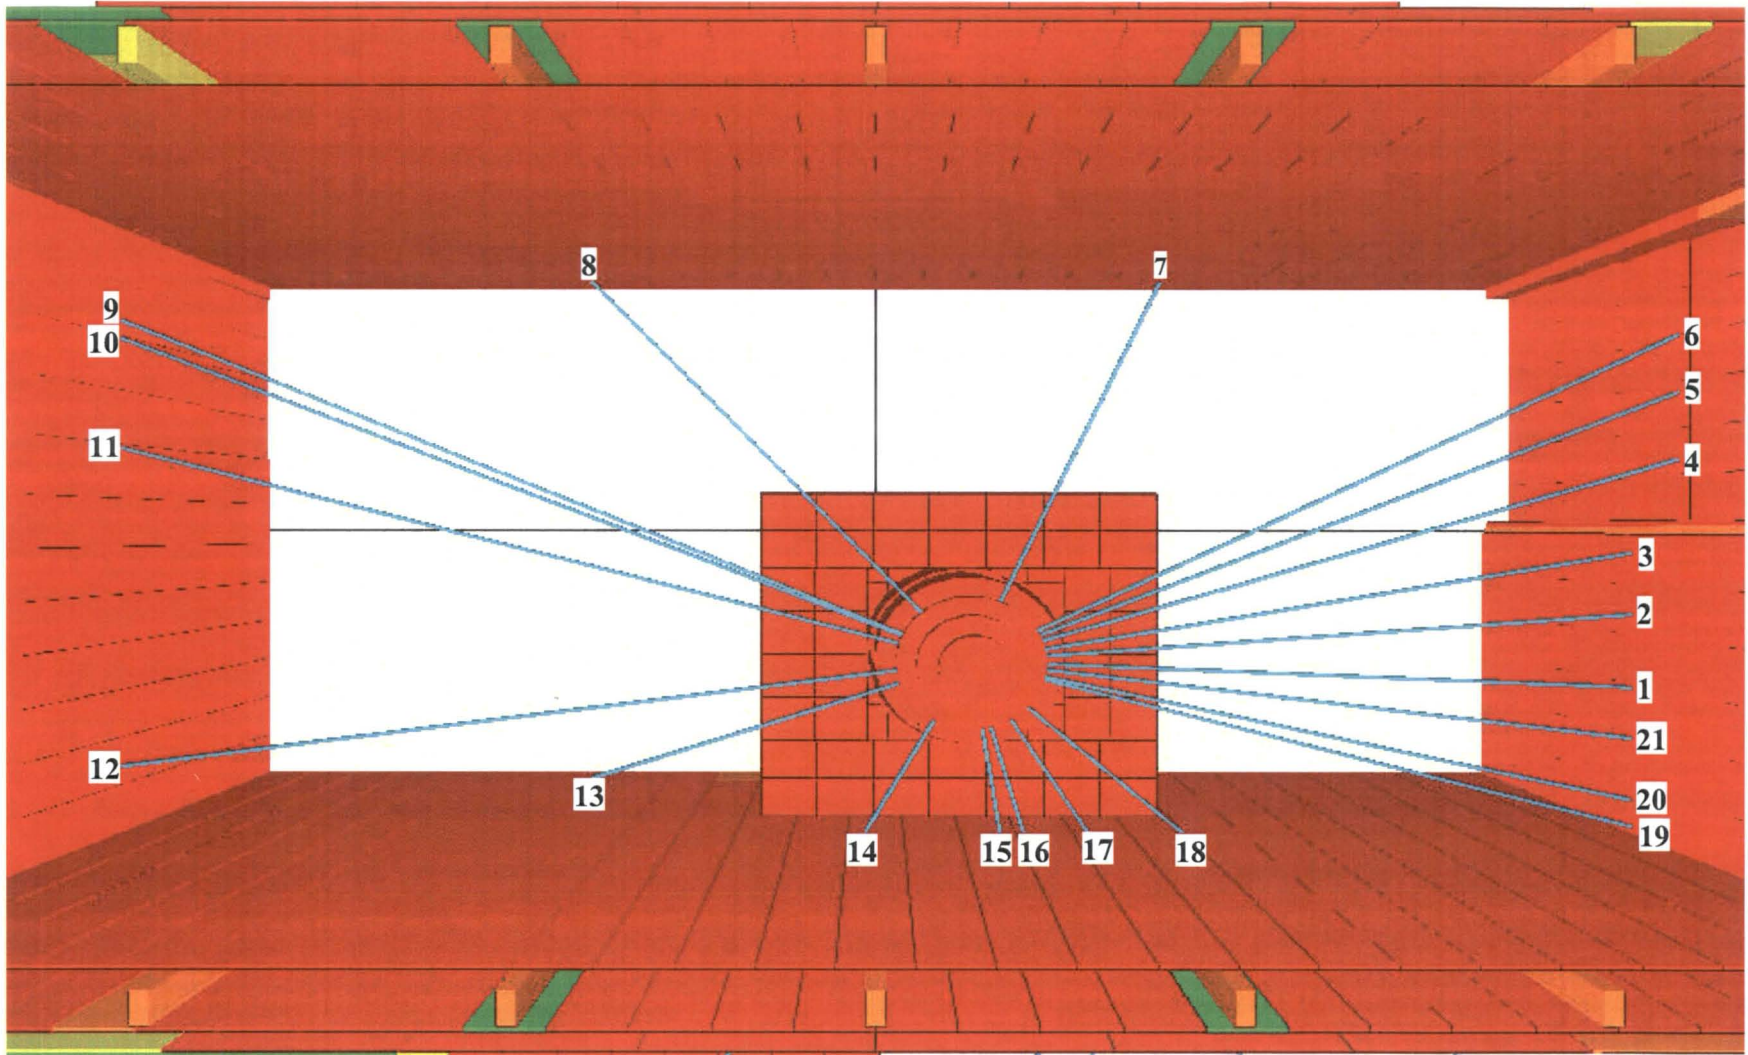


Figure 18. Secondary Fragment Paths for MPPF



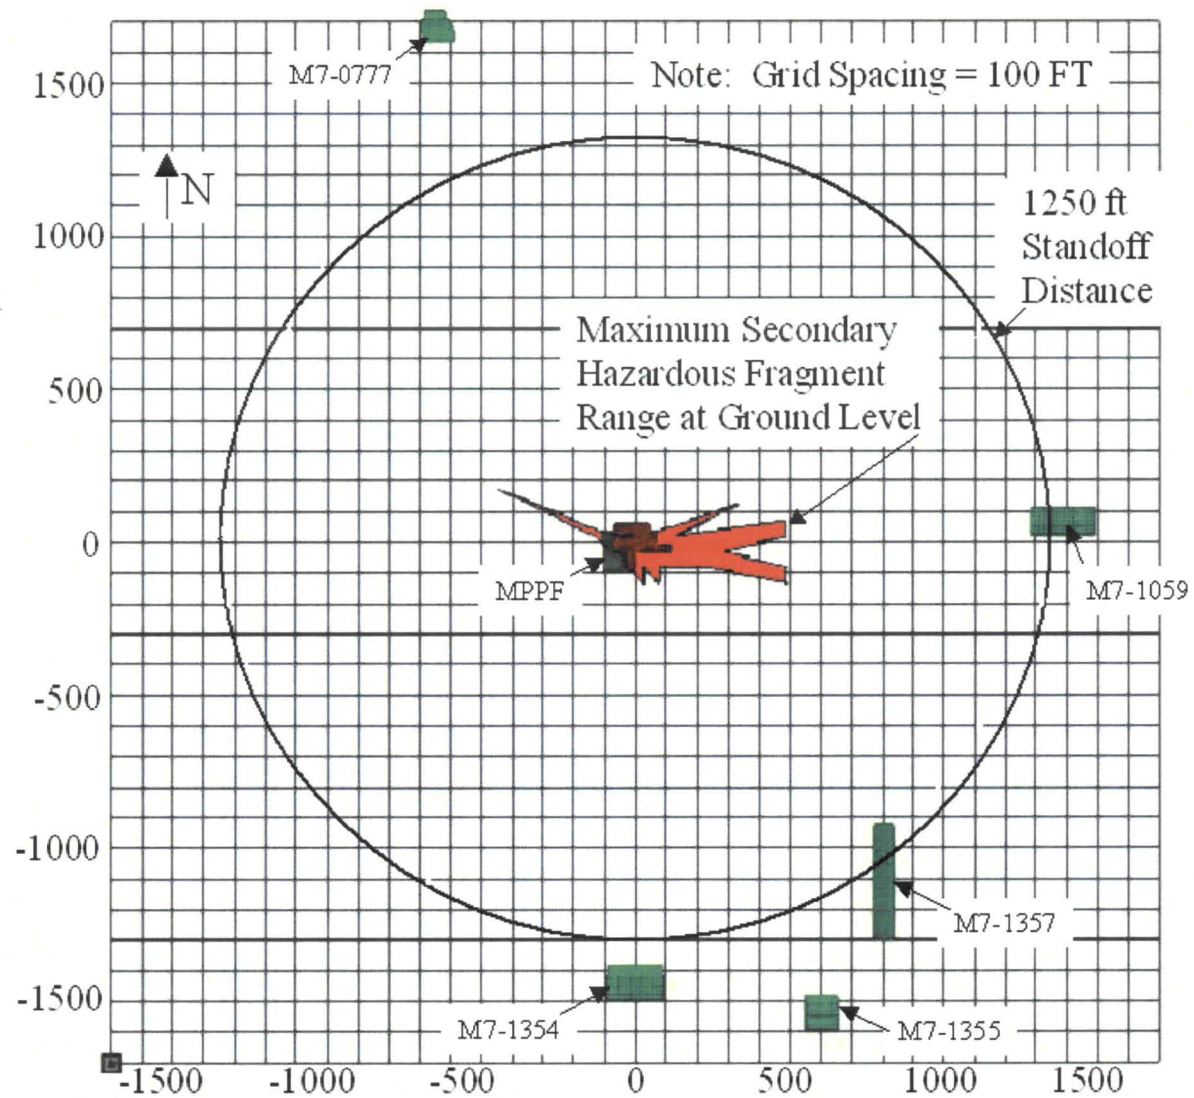


Figure 19. Secondary Hazardous Fragment Range Distribution



## 6.0 CONCLUSIONS

Based on the results of the analyses described in Section 2.0 through 5.0, the following conclusions are reached:

- 1) Blast hazards are limited primarily to the MPPF.
- 2) Primary fragment hazards represent the greatest concern to surrounding KSC buildings with ranges extending out to 898 feet beyond the MPPF perimeter.

Secondary hazardous fragment ranges extend out no more than 420 feet and pose minimal hazard to nearby KSC structures.

## 7.0 REFERENCES CITED

1. Tatom, F. B., "Crew Exploration Vehicle/Orion, Explosion Hypergol Blast Study Pertaining to Multi-Payload Processing Facility (MPPF) (CxP MPPF Upgrade Project Support, Phase I), Final Report", EAI-TR-09-007R2, ASRC Aerospace, Inc., Kennedy Space Center, Florida, July 2009.
2. "Analysis Assumptions and Definitions for KSC Blast Modeling of the Crew Exploration Vehicle/Service Module", NASA, Kennedy Space Center, Florida, May 22, 2009.
3. "Safety Standard for Explosives, Propellants, and Pyrotechnics", NSS 1740.12, National Aeronautics and Space Administration, Office of Safety and Mission Assurance, Washington, DC, August 1993.
4. "DOD Ammunition and Explosive Safety Standards", DOD 6055.9-STD, Department of Defense, Washington, DC, July 1999.
5. "DOD Contractors' Safety Manual for Ammunition and Explosives", DOD 4145.26-M, Department of Defense, Washington, DC, September 1997.
6. Departments of the Army, the Navy, and the Air Force, "Structures to Resist the Effects of Accidental Explosions, TM 5-1300/NAVFAX P-397/ARF 88-22", ADA176673, Departments of the Army, the Navy, and the Air Force, Washington, DC, November 1990.
7. Tatom, F. B., "High Explosive Damage Assessment Model, Seventh Industrial Version (HEXDAM 7.0) Training Course", EAI-SP-09-001, Engineering Analysis Inc., Huntsville, Alabama, January 2009.
8. Tatom, F. B., "Primary Fragmentation Analysis", Engineering Analysis Inc., Huntsville, Alabama, July 2002.
9. Thomas, L. H., "Computing the Effect of Distance on Damage by Fragments", BRL Report No. 468, Aberdeen Proving Ground, Maryland, May 1944.

10. Dunn, D.J., Jr., and Porter, W.R., "Air Drag Measurements of Fragments", BRL 915, Ballistic Research Laboratories, Aberdeen Proving Ground, Maryland, August 1955.
11. "Calculating Fragment Penetration and Velocity Data for Use in Vulnerability Studies", NAVORD Report 6621, U.S. Naval Nuclear Ordnance Evaluation Unit Albuquerque, New Mexico, October 1959.
12. Rindner, R. M., and Wachtell, S., "Safe Distances and Shielding for Prevention of Propagation of Detonation by Fragment Impact", Technical Report DB-TR: 6-60, Ammunition Group, Picatinny Arsenal, Dover, New Jersey, December 1960.
13. Healey, J., Werner, H., Weissman, S., and Dobbs, N. "Primary Fragment Characteristics and Impact Effects on Protective Barriers", Technical Report 4903, Picatinny Arsenal, Dover, New Jersey, December 1975.
14. "A Manual for the Prediction of Blast and Fragment Loadings on Structures", DOE/TIC 11268, United States Department of Energy, February 1992.
15. Tatom, F. B., "Crew Exploration Vehicle/Orion, Explosion Quantity-Distance Hypergol Blast Study Pertaining to the Multi-Payload Processing Facility (MPPF), Final Report", EAI-TR-07-012, ASRC Aerospace, Inc., Kennedy Space Center, Florida, December 14, 2007.
16. Tatom, F.B., Cleland, J.M., and Thompson, J.D., "Crew Exploration Vehicle/Orion, Explosion Quantity-Distance Hypergol Blast Study Pertaining to the Multi-Payload Processing Facility (MPPF), Phase II, Final Report", EAI-TR-08-013, ASRC Aerospace, Inc., Kennedy Space Center, Florida, September 4, 2008.
17. Tatom, F. B., "High Explosive Fragmentation (HEXFRAG) Training Course", EAI-SP-09-004, Engineering Analysis Inc., Huntsville, Alabama, January 2009.